


Y:\0000\CADD STANDARDS\CITY DETAILS\City Details\Easton MID\DETAILS\PW-2.03.dwg Apr 04, 2011 - 3:41pm, (batn)

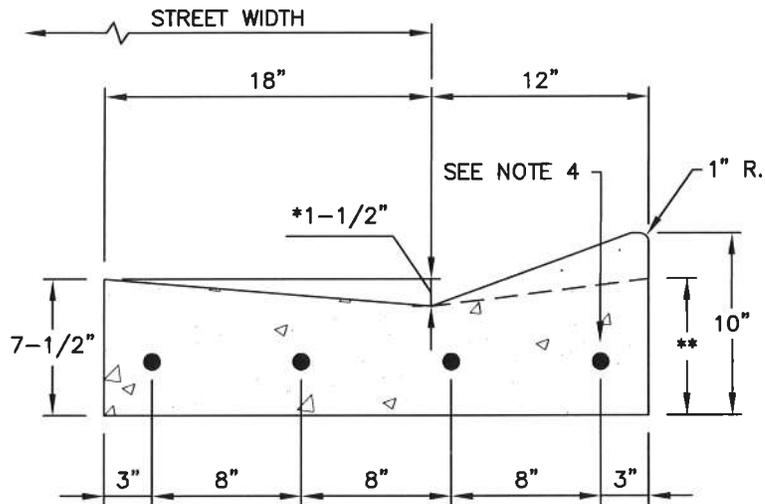

NOTES:

1. ALL CONCRETE USED FOR CURB & GUTTER SHALL BE SHA MIX NO. 7.
2. CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 40'-0". EXTRUDED CONCRETE CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 100'-0".
3. MOUNTABLE CURB MAY BE USED IN SINGLE FAMILY RESIDENTIAL ONLY AND ONLY UPON APPROVAL BY TOWN ENGINEER.
4. ALL DRIVEWAYS AND HANDICAP RAMPS REQUIRE 4 PIECES OF EPOXY COATED #6 REBAR, EQUALLY SPACED THE FULL WIDTH OF THE DEPRESSED CURB.
5. DO NOT UTILIZE AT HANDICAP RAMP UNLESS FRONT SLOPE  $\leq$  20:1 (5%) AND BACK SLOPE  $\leq$  12:1.
- \* 6. RISE AT H/C RAMPS SHALL BE  $\frac{7}{8}$ ".
- \*\* 7. CURB HEIGHT SHALL BE  $\frac{7}{8}$ " AT H/C RAMPS.

|   |            |   |
|---|------------|---|
| <p>APPROVAL</p> <p><i>[Signature]</i> 4/12/11<br/>TOWN ENGINEER      DATE</p> | REVISED    | <p>TOWN OF EASTON<br/>AND<br/>EASTON UTILITIES<br/>STANDARD DETAILS</p> <p>MOUNTABLE CURB</p> |
|   | JAN 1, 94  |   |
|   | AUG 1, 94  |   |
|   | DEC 12, 94 |   |
|   | FEB 1, 02  |   |
|   | FEB 25, 09 |   |
| ISSUED: MAY 1, 1989   | JAN 1, 11  | STANDARD NO. PW-2.03  |