



Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-3.00.dwg Apr 04, 2011 - 3:44pm, (batn)

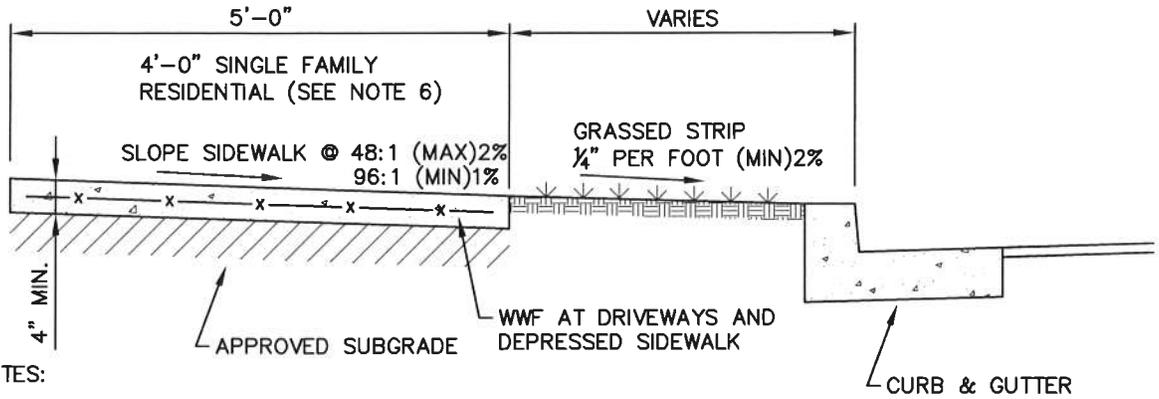

**NOTES:**

1. CONCRETE SHALL BE SHA MIX NO. 3.
2. CONTRACTION JOINTS SHALL BE TOOLED AT 5'-0" INTERVALS. (4' INTERVALS FOR 4' WIDE SIDEWALK)
3. EXPANSION JOINTS AT INTERVALS NOT GREATER THAN 20'-0".
4. ALL UNPAVED AREAS WITHIN STREET SIDELINES SHALL BE SEEDED OR SODDED PER SPECIFICATIONS.
5. SIDEWALKS AT DRIVEWAY LOCATIONS TO BE 6" THICK WITH 6" x 6" WITH W1.4xW1.4 WOVEN WIRE MESH.
6. WHERE CONTINUOUS WIDTH OF TRAVEL IS LESS THAN 5'-0", PROVIDE SIDEWALK PASSING ZONES AT AN INTERVAL NOT TO EXCEED 200' CENTER TO CENTER. ENTRANCES SHALL BE ACCEPTABLE PASSING ZONES PROVIDED PAVING WIDTH OF 5'-0" IS MAINTAINED AT 48:1 SLOPE.
7. GRASS STRIPS SHALL BE SLOPED AS TO PROVIDE POSITIVE DRAINAGE TOWARD STORMWATER FEATURES.
8. WHERE REVERSE SLOPES OF GRASS STRIPS AND SIDEWALKS ARE REQUIRED TO PROVIDE POSITIVE DRAINAGE TOWARD A STORMWATER FEATURE, SPOT ELEVATIONS SHALL BE PROVIDED ON FRONT AND BACK OF SIDEWALK. (REVERSE SLOPES MUST BE APPROVED BY THE TOWN PRIOR TO CONSTRUCTION)
9. MAXIMUM SLOPE IN THE DIRECTION OF TRAVEL SHALL BE 5% IN LOCATIONS WITHOUT HANDICAPPED RAMPS.
10. SIDEWALKS SHALL COMPLY WITH ADA REQUIREMENTS PER THE MOST UP TO DATE DEPARTMENT OF JUSTICE REGULATION 28CFR PART 36.

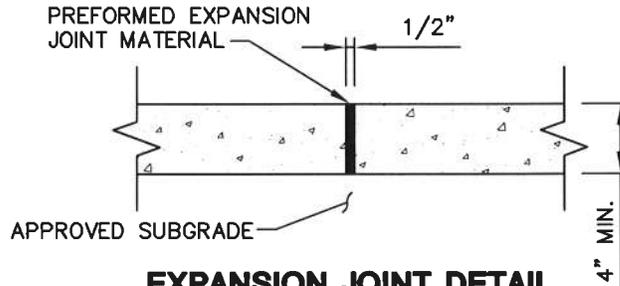

**EXPANSION JOINT DETAIL**

<p><b>APPROVAL</b></p> <div style="text-align: center;">               TOWN ENGINEER         </div> <div style="text-align: right; margin-top: 10px;">             4/12/11              DATE         </div>	<p><b>REVISED</b></p> <p>AUG 1, 94</p> <p>FEB 1, 02</p> <p>FEB 1, 06</p> <p>MAR 16, 07</p> <p>OCT 11, 10</p>	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</p> <p><b>SIDEWALK</b></p>
<p><b>ISSUED: MAY 1, 1986</b></p>	<p>JAN 1, 11</p>	<p><b>STANDARD NO. PW-3.00</b></p>