


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-4.08.dwg Sep 17, 2014 - 1:10pm, (merj)

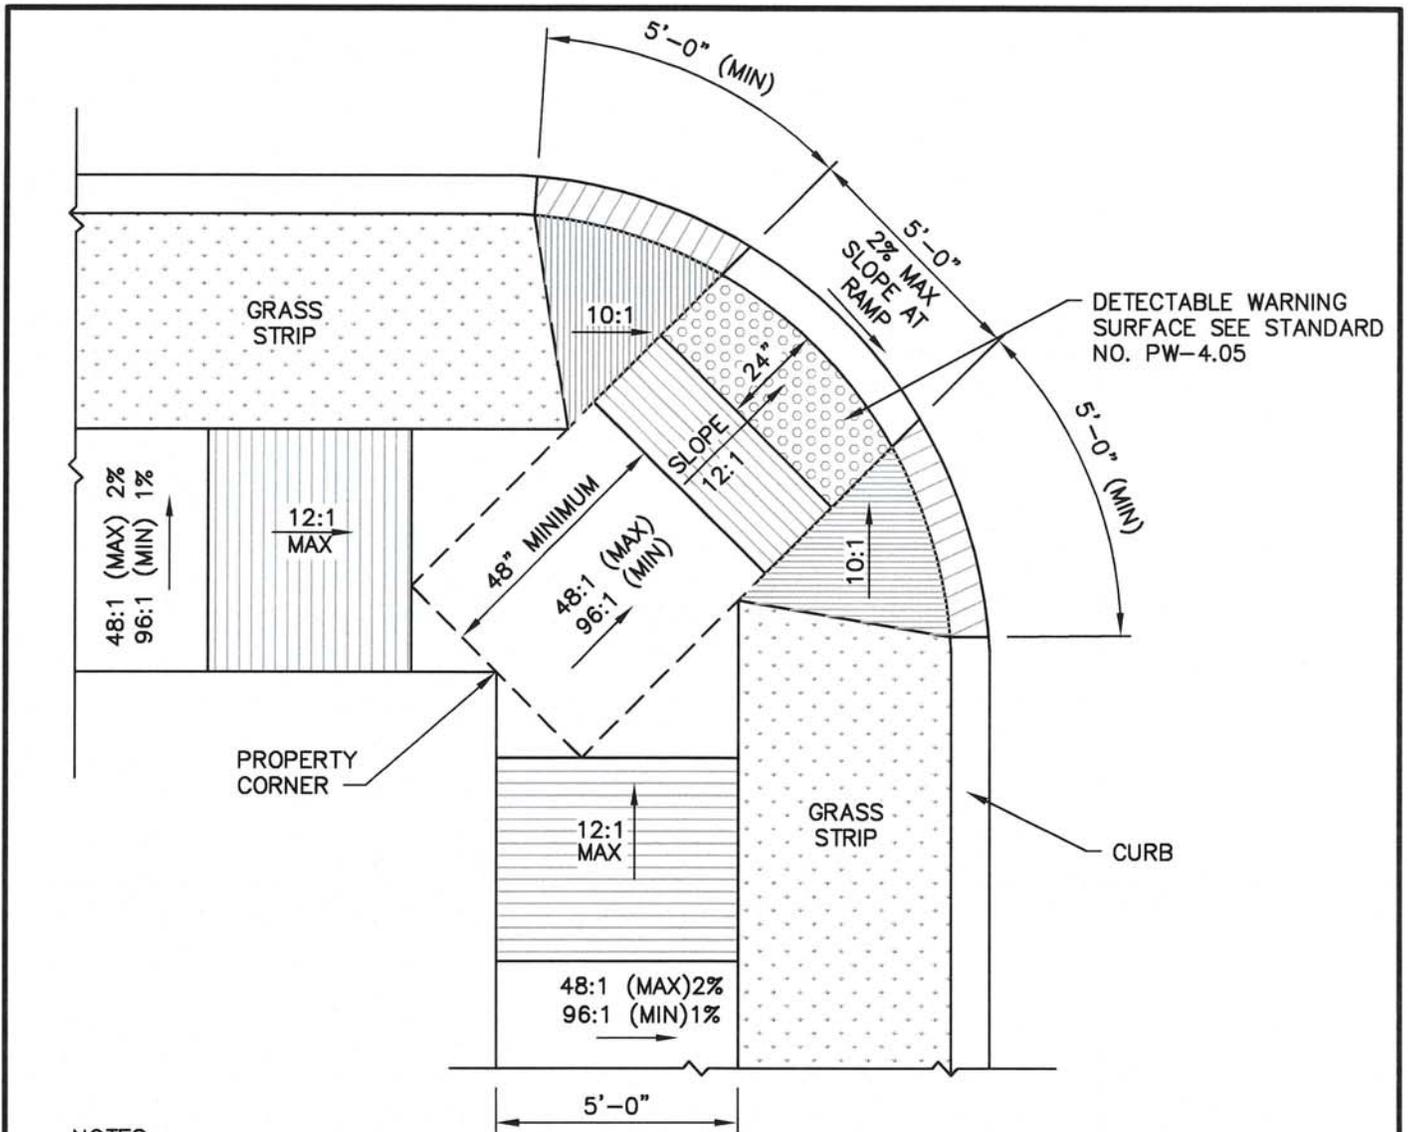

NOTES:

1. SURFACE TEXTURE OF RAMPS SHALL BE COARSE BROOMING OR NON-SKID TYPE SURFACE.
2. SEE STANDARD NO. PW-2.01 FOR DEPRESSED CURB.
3. SEE STANDARD NO. PW-4.02 FOR ELEVATION.
4. MAX. SLOPE FOR RAMP TAPERS SHALL BE 10:1 (10%).
5. TO BE USED WHERE $\geq 5'$ EXIST BETWEEN FACE OF CURB AND FRONT OF SIDEWALK.
6. HANDICAPPED RAMPS SHALL BE REINFORCED WITH 6x6 W1.4xW1.4 WELDED WIRE MESH.
7. HANDICAPPED RAMPS SHALL CONTAIN A 6" THICK CONCRETE SECTION.
8. AT NO POINT SHALL THE SLOPE OF THE LANDING BE GREATER THAN 48:1 (2%), INCLUDING DIAGONAL.
9. THERE SHALL BE A LANDING PRIOR TO THE RAMPS. THE LANDING SHALL BE 36" IN LENGTH, MINIMUM.

<p>APPROVAL</p> <div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: center;"> TOWN ENGINEER </div> <div style="text-align: center;"> 7/15/14 DATE </div> </div>	<p>REVISED</p> <p>JAN 1, 11</p> <p>SEP 17, 14</p>	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</p> <p>TYPE "E" SIDEWALK RAMP</p>
<p>ISSUED: FEB 25, 2009</p>	<p>STANDARD NO. PW-4.08</p>	