


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-4.11.dwg Apr 04 , 2011 - 3:57pm. (batm)

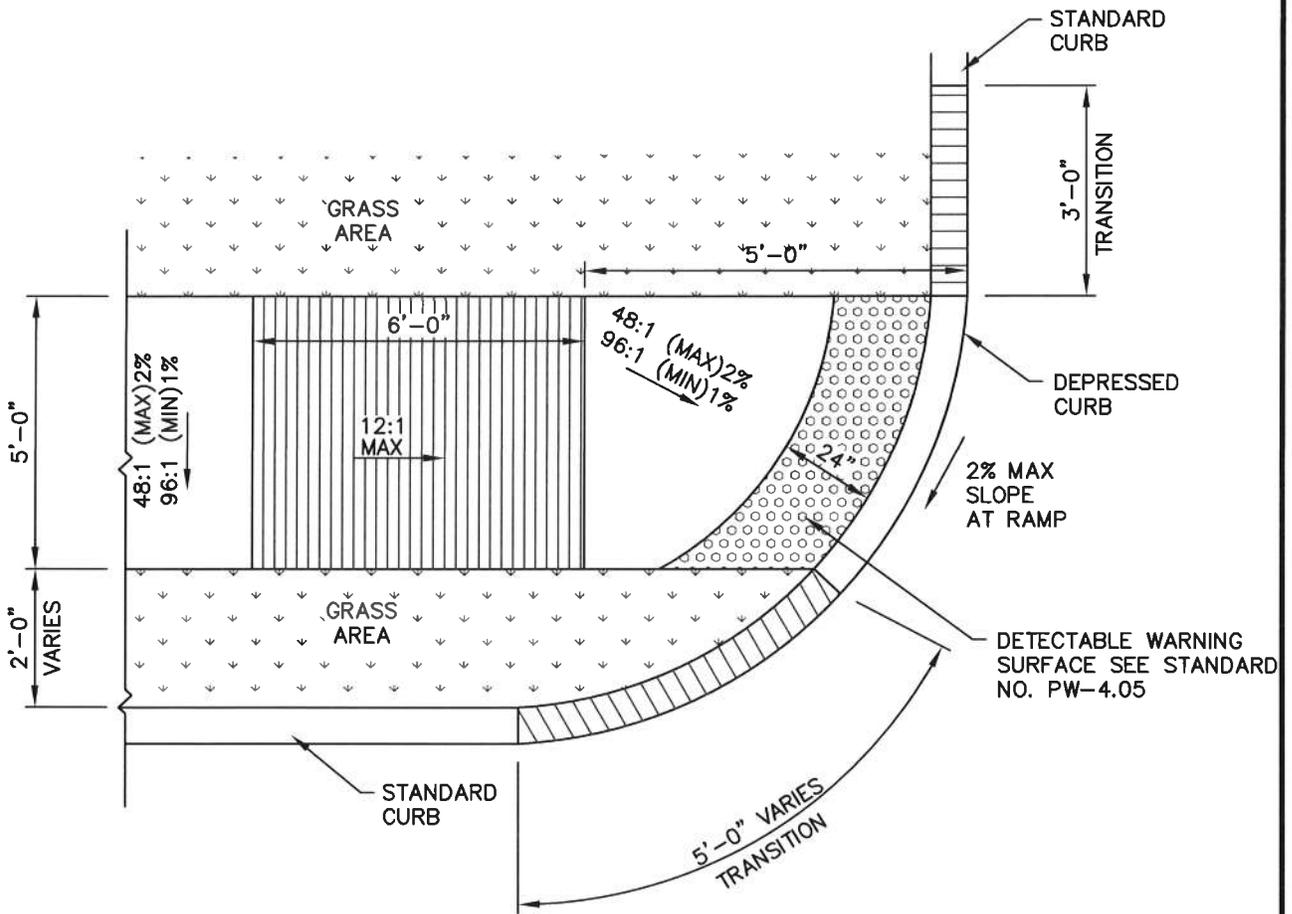

NOTES:

1. SURFACE TEXTURE OF RAMPS SHALL BE COARSE BROOMING OR NON-SKID TYPE SURFACE.
2. SEE STANDARD NO. PW-2.01 FOR DEPRESSED CURB.
3. SEE STANDARD NO. PW-2.00 FOR STANDARD CURB.
4. BRICK SIDEWALK AND HANDICAP RAMPS SHALL BE USED AS DIRECTED BY THE TOWN. SEE STANDARD NO. PW-3.01 FOR BRICK SIDEWALK DETAIL.
5. HANDICAPPED RAMPS SHALL BE REINFORCED WITH 6x6 W1.4xW1.4 WELDED WIRE MESH.
6. HANDICAPPED RAMPS SHALL CONTAIN A 6" THICK CONCRETE SECTION.
7. AT NO POINT SHALL THE SLOPE OF THE LANDING BE GREATER THAN 48:1 (2%), INCLUDING DIAGONAL.
8. THERE SHALL BE A LANDING PRIOR TO THE RAMPS. THE LANDING SHALL BE 36" IN LENGTH, MINIMUM.

APPROVAL

M. J. Jundel 4/12/11
 TOWN ENGINEER DATE

REVISED

JAN 1, 11

TOWN OF EASTON
 AND
 EASTON UTILITIES
 STANDARD DETAILS

TYPE "H" SIDEWALK RAMP

ISSUED: MAY 14, 2009

STANDARD NO. PW-4.11