



Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\SD-3.04.DWG Mar 30, 2011 - 4:27pm, (tayv)

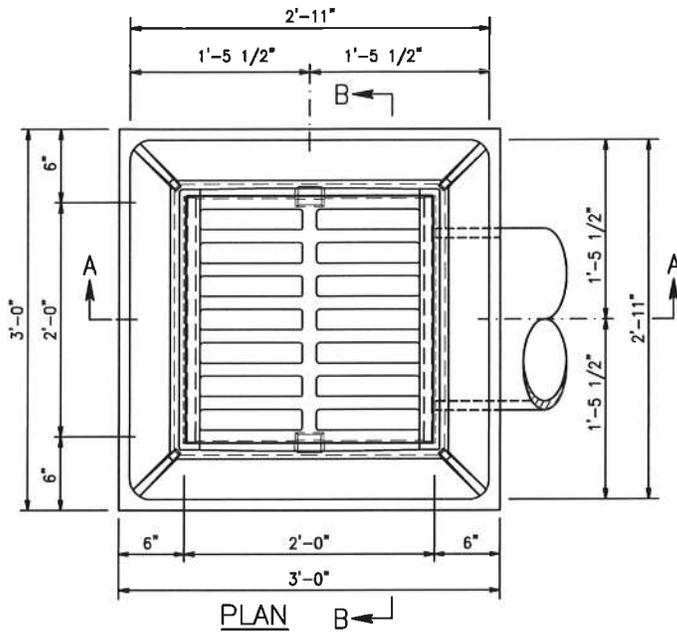

GENERAL NOTES

1. CONCRETE TO BE MIX 4500 PSI
2. REINFORCING-2 LAYERS OF 4x4-W4.0x W4.0 WELDED WIRE FABRIC.
3. THREADED PLASTIC INSERTS TO BE PROVIDED FOR HANDLING.
4. FRAME AND GRATE TO BE NEENAH #R-3348 HEAVY DUTY CONCAVE GUTTER INLET FRAME AND GRATE OR APPROVED EQUAL.
5. GRADE AND SLOPE ADJUSTMENTS TO BE COMPLETED IN THE FIELD USING CONCRETE OR BRICK AND MORTAR. MIN. ONE LAYER OF BRICK OR 3" OF CONCRETE.
6. PIPE OPENINGS TO BE PROVIDE AS REQUIRED, FOR SIZE, LOCATION AND INVERT ELEVATIONS.
7. MINIMUM DEPTH PAYMENT PER "EACH" INLET INCLUDES DEPTHS UP TO 3'-6" MEASURED FROM THE PIPE INVERT TO THE TOP OF THE GRATE. VERTICAL DEPTH PAYMENT PER LINEAR FOOT FOR DEPTHS IN EXCESS OF 3'-6".
8. INVERT TO BE CONCRETE OR BRICK AND SHALL SLOPE 2" PER FOOT TOWARD OUTLET OR AS DIRECTED BY THE ENGINEER.

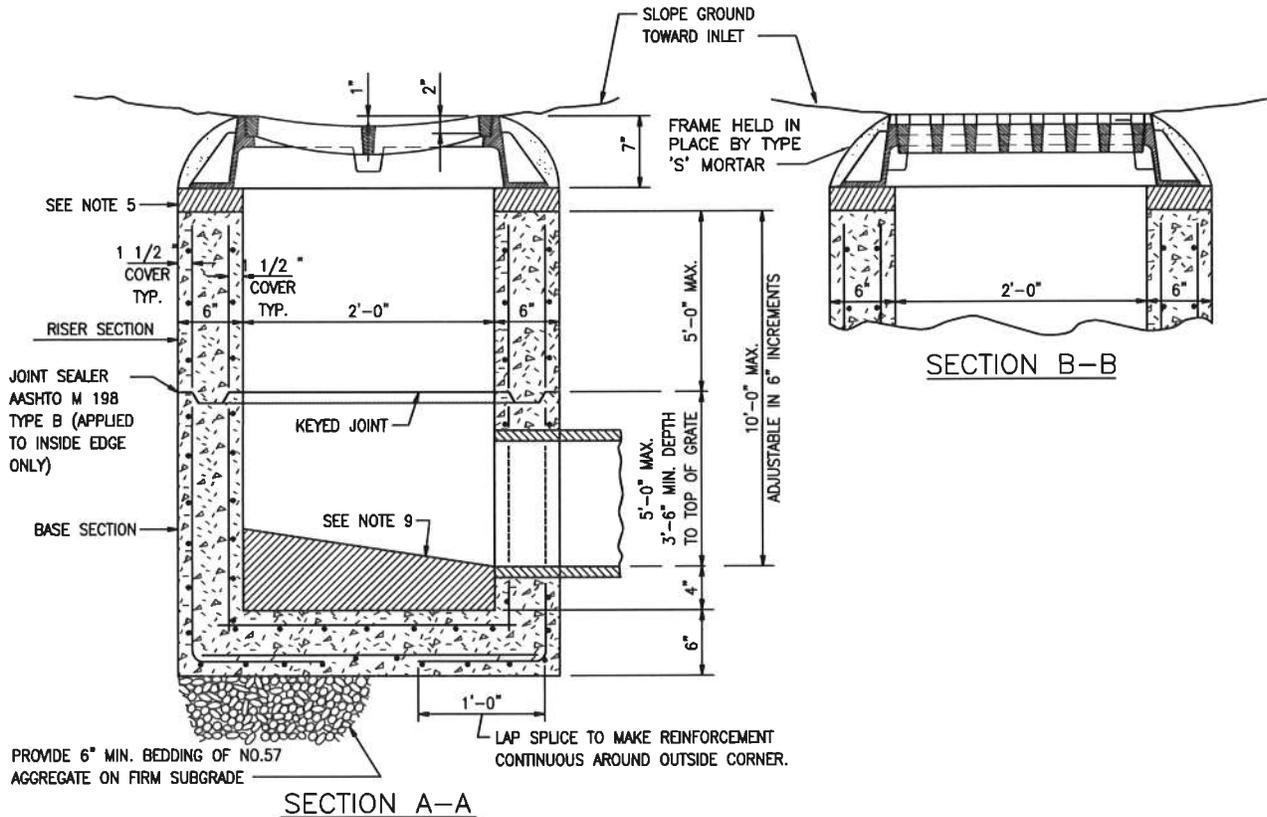

APPROVAL

M. J. F. del 4/12/11
 TOWN ENGINEER DATE

REVISED

TOWN OF EASTON
 AND
 EASTON UTILITIES
 STANDARD DETAILS

TRAFFIC BEARING YARD INLET

ISSUED: MARCH 30, 2011

STANDARD NO. SD-3.04